

Rees Presidio “On the Go” Web Browser

Changing Alarm Parameters


1. **To access the Rees system, you must be on the NIH network (either onsite or VPN). Type in your URL 165.xxx.xx.xx into the bar at the top of any web browser.**
2. **Log in to the Rees system with your lab’s user name and password.**

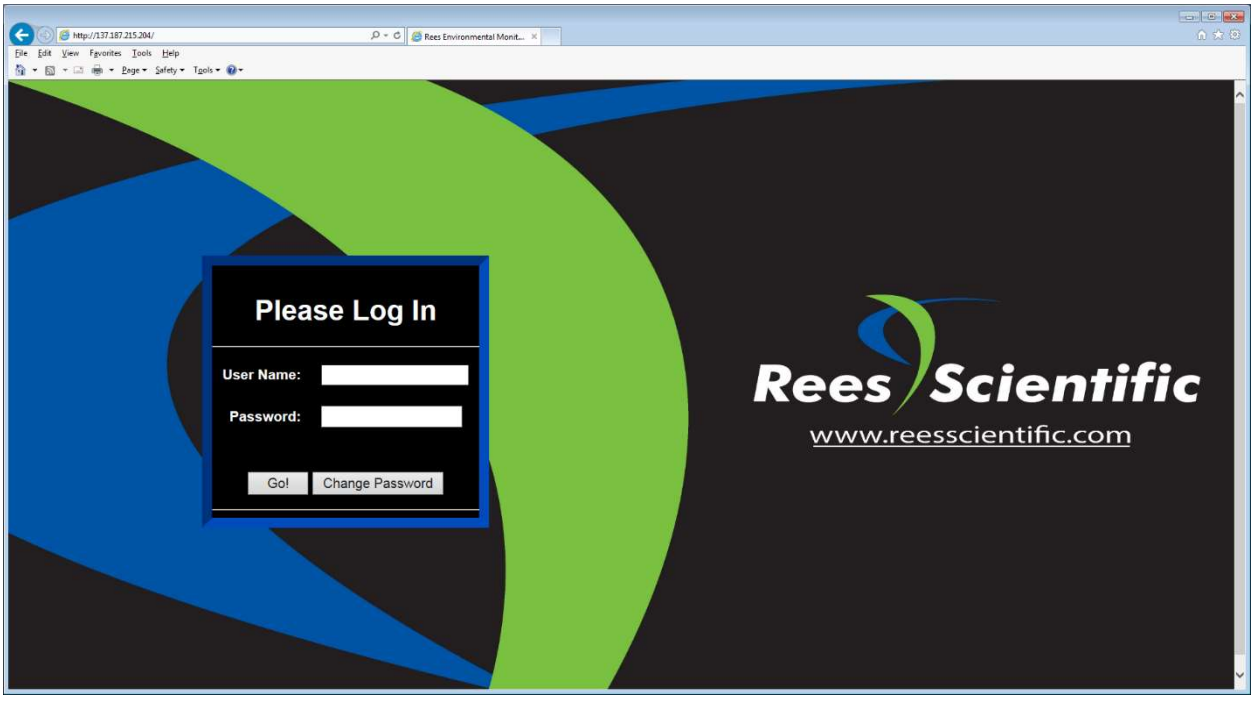


3. **Click on the input you want to change the alarm ranges on.**

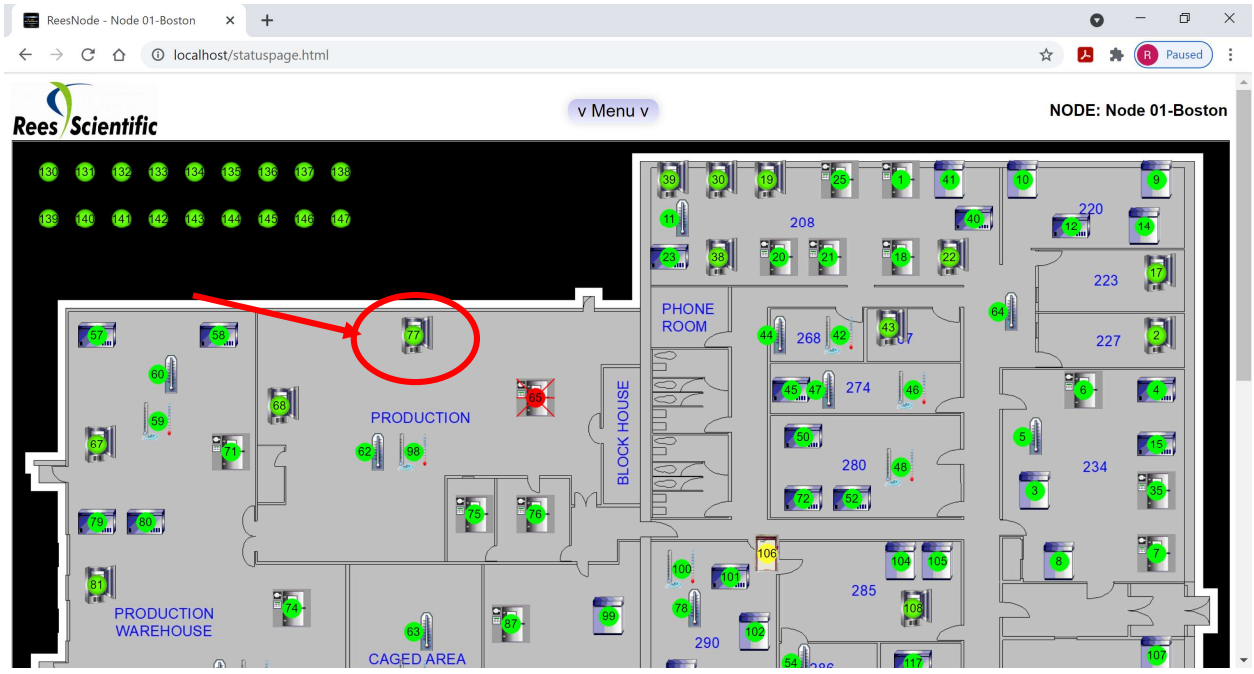

4. **The following window will be displayed. Click "Program Input" icon**

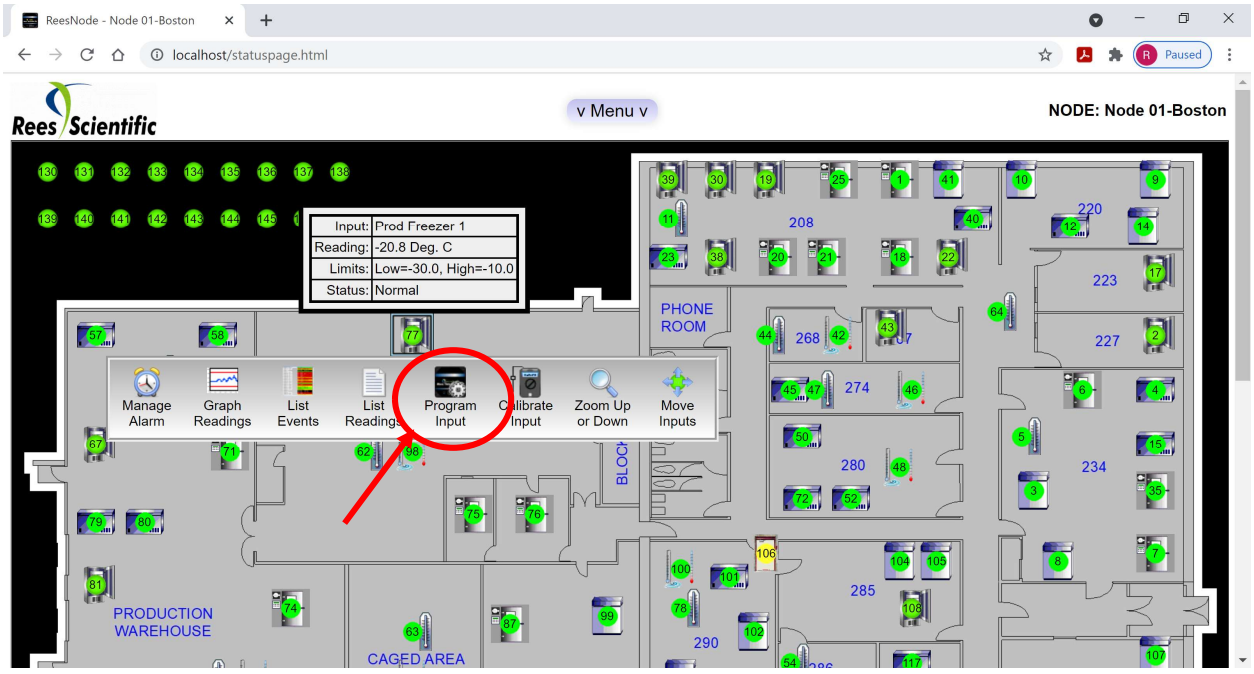

5. **The following menu will be displayed. Click the Alarm Icon.**

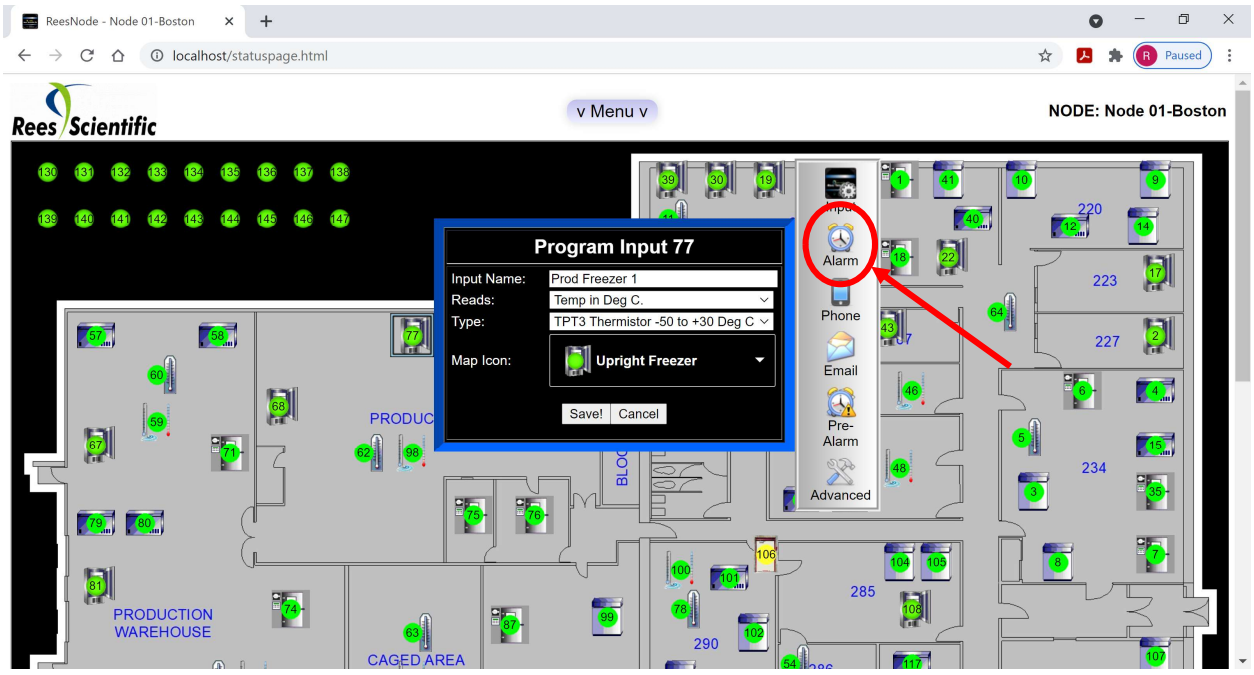

6. **The following menu will be displayed. Change Alarm limits to new ranges, and click Save!**

